

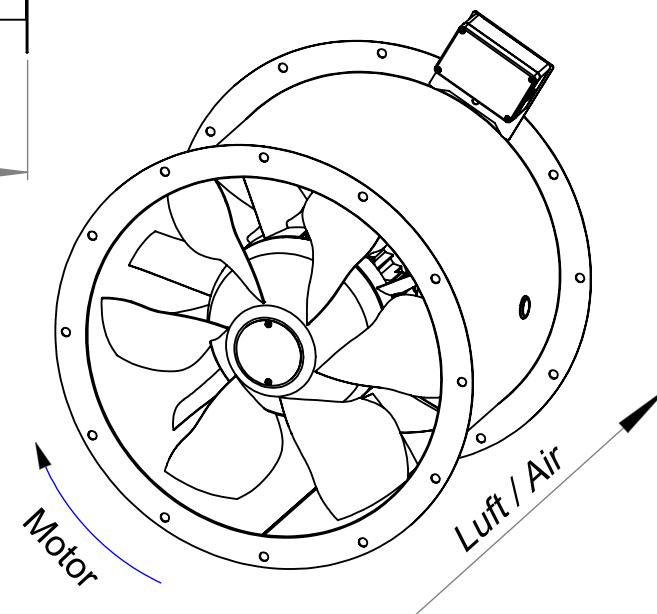
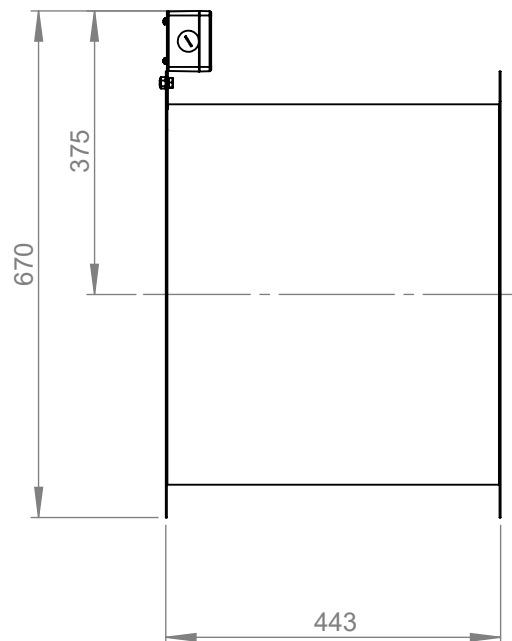


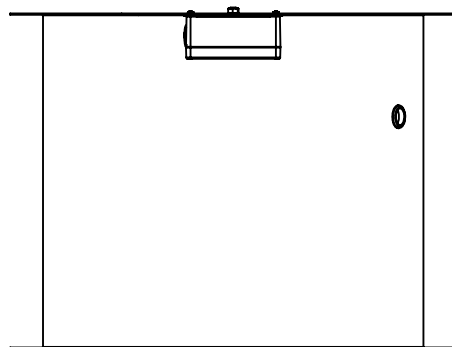

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

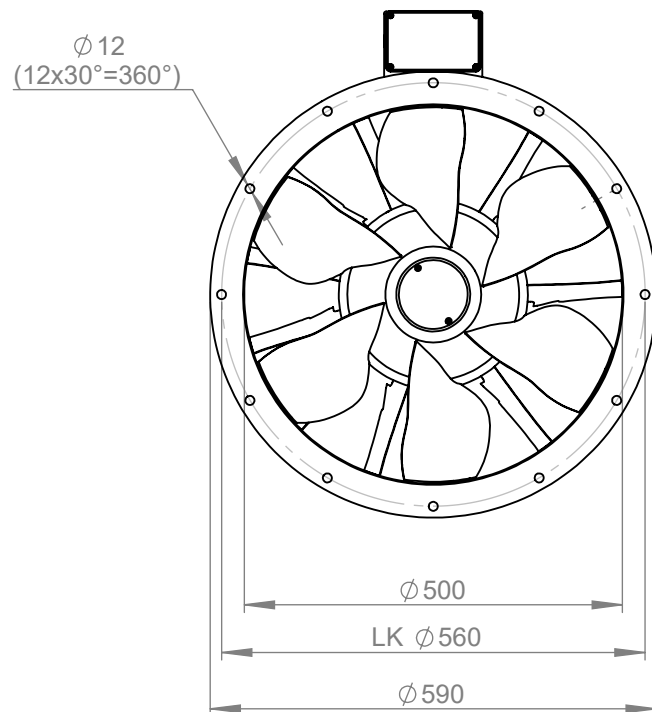

Protection Mark
according to ISO 16016

Created co.huegel
Drawn co.huegel
Released d.hancu
Disabled

1:10 A4 mm

General tolerances
DIN ISO 2768-c

06.05.2020
06.05.2020
13.12.2021

AL500D4F401

154710 00