


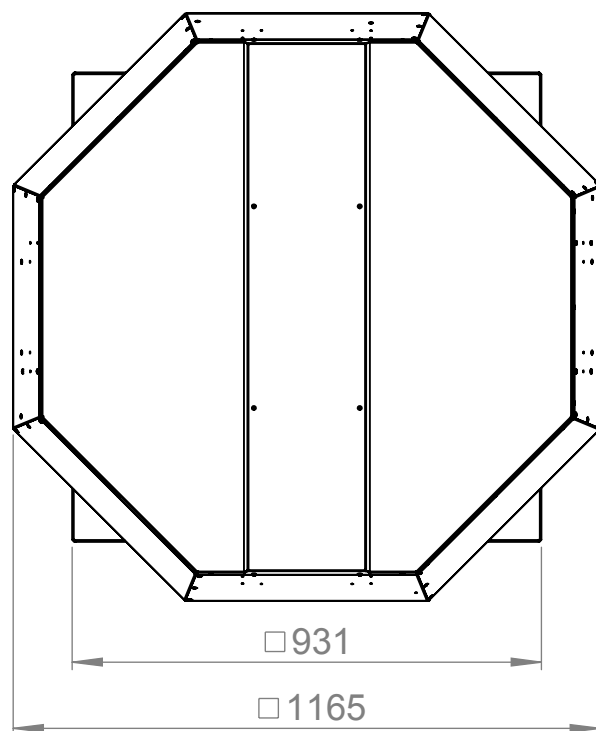


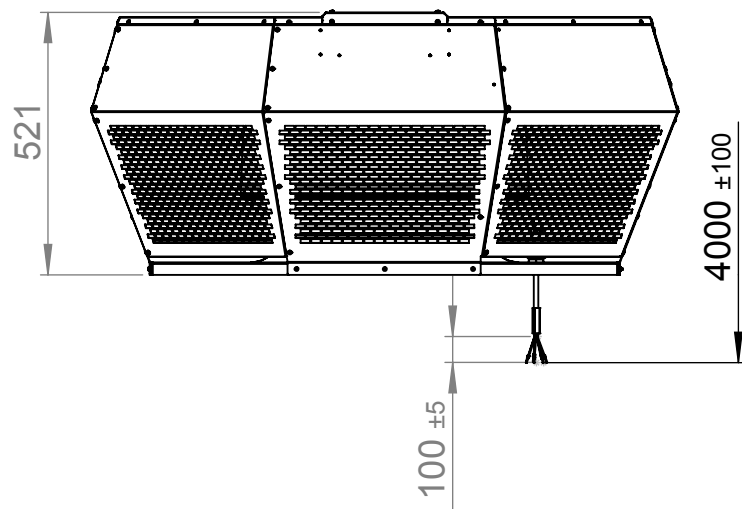

cable outlet

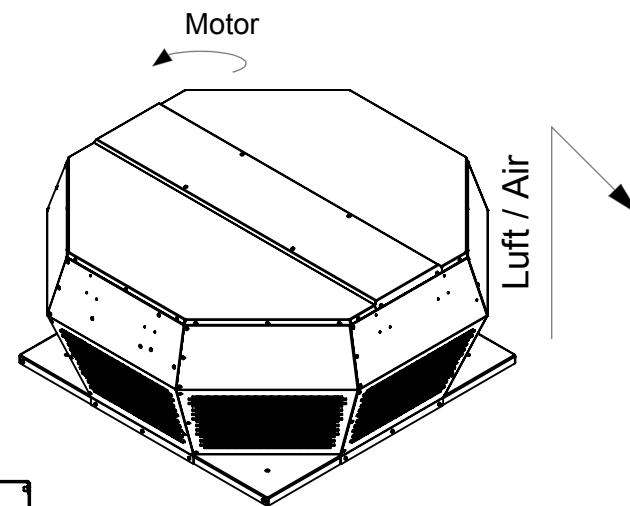

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

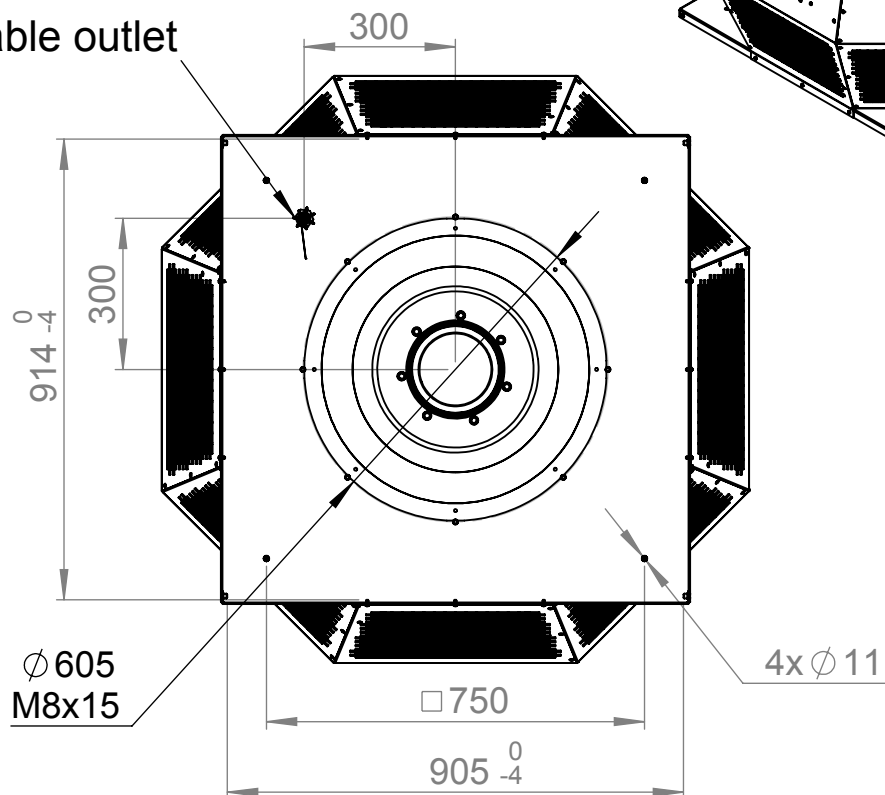

Protection Mark
according to ISO16016

Created I.benk
Drawn I.benk
Released v.brand
Disabled

1:15 A4 mm

General tolerances
DIN ISO 2768-c

26.11.2014
26.11.2014
15.07.2019

DHA560D430+

131104 00