

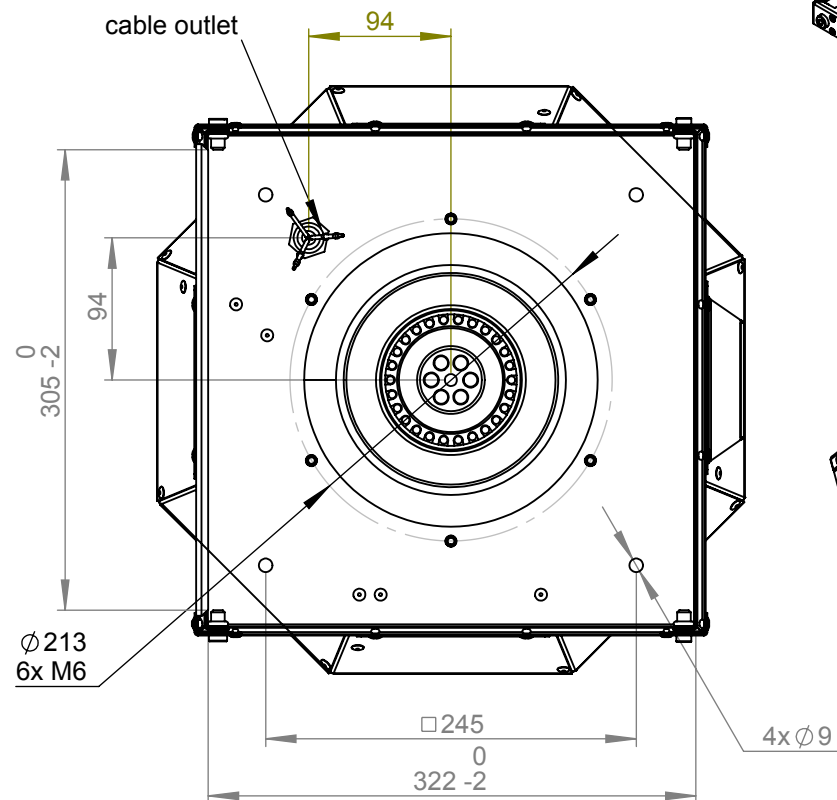
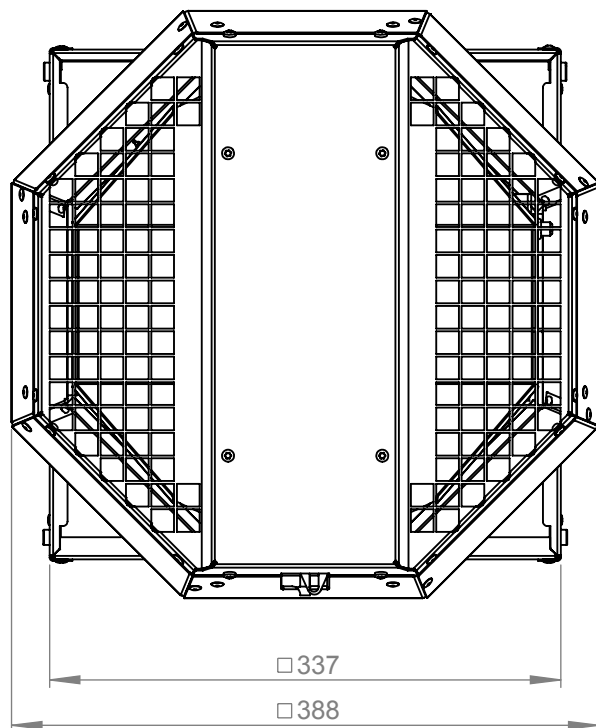
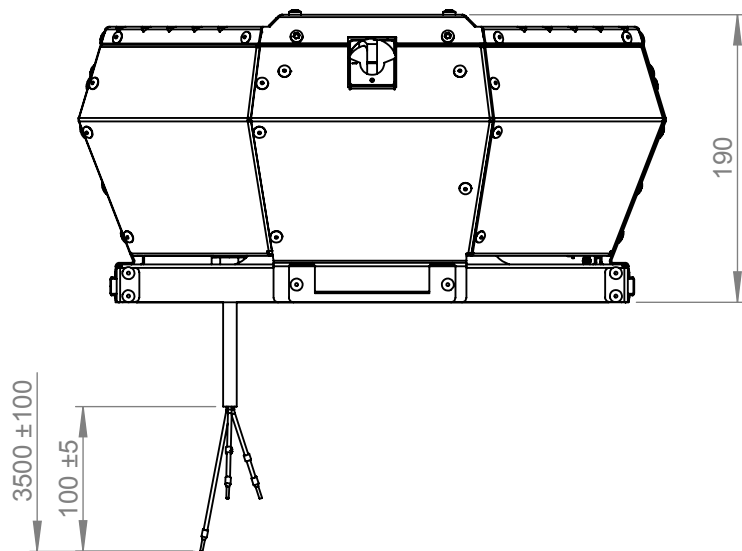


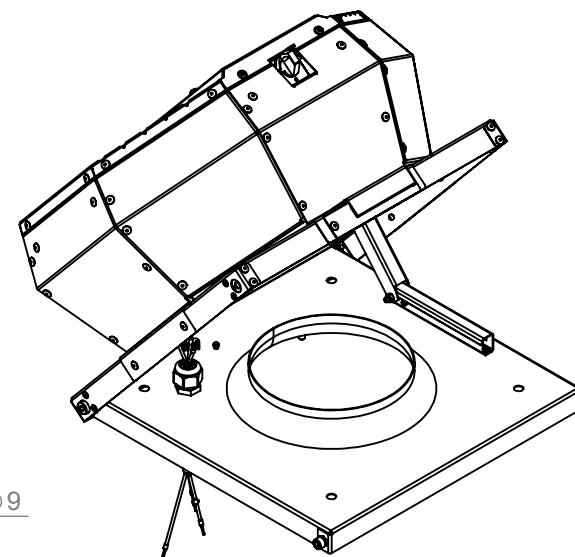

cable outlet

94

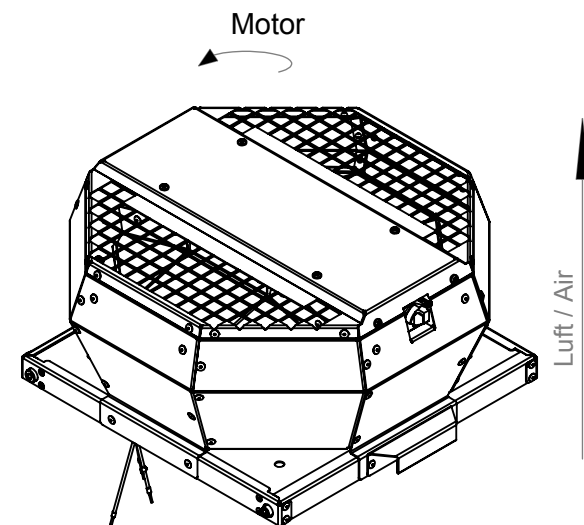

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg



Protection Mark
according to ISO 16016

Drawn: s.pop
Created: s.pop
Changed:

1:5 A4 mm

General tolerances
DIN ISO 2768-c

31.03.2017
31.03.2017

DVA220E2P31

139339 00